



MERCURY DISPLACEMENT INDUSTRIES, INC.

Post Office Box 710 - U.S. 12 East - Edwardsburg, Michigan 49112-0710

Phone (269) 663-8574 - Fax (269) 663-2924


(800) 634-4077

DORC-120ATSU-5

NORMALLY CLOSED TIME DELAY RELAY

 939S LISTED INDUSTRIAL CONTROL EQUIPMENT

 LR 41198 CERTIFIED

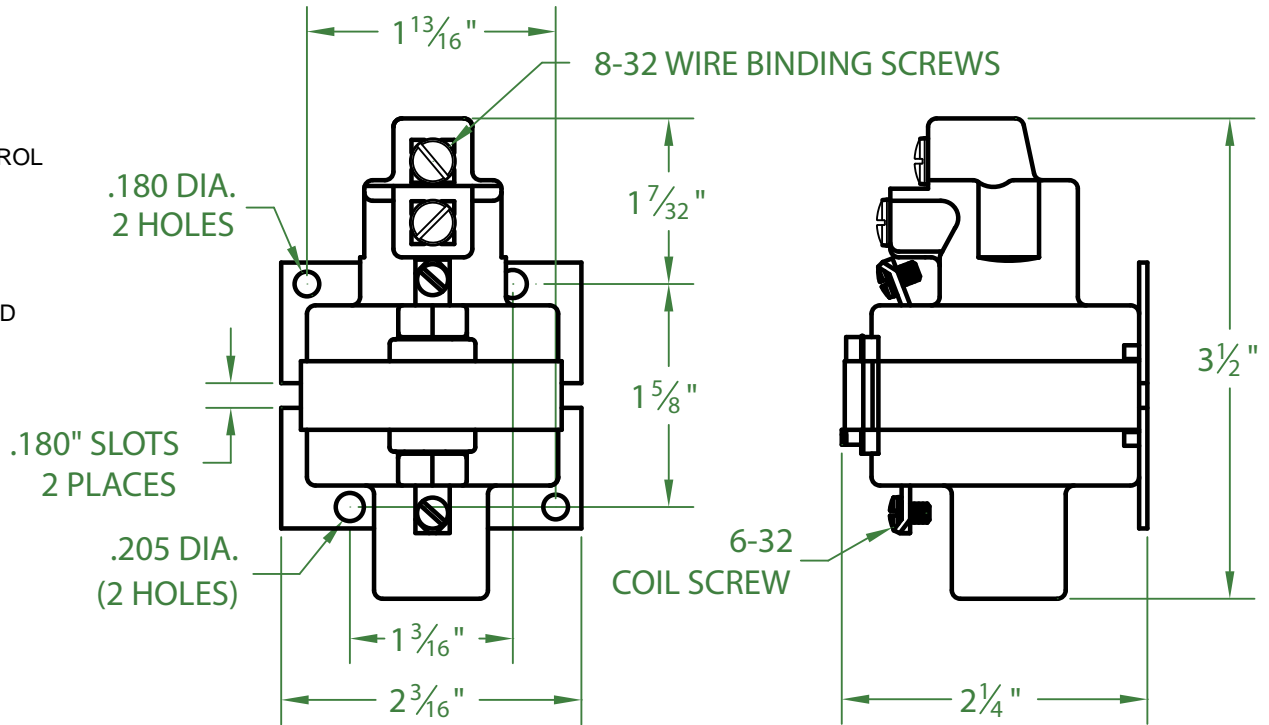

- * DIELECTRIC WITHSTAND 2,500 VAC RMS
- * OPERATE TIME 5 SECONDS
- * RELEASE TIME 5 SECONDS
- * RATINGS:
CONTACTS: 10 AMPS @ 120 VAC
PILOT DUTY RATING 720 VA
COIL: 120V 50/60 Hz
- * TEMPERATURE RANGE -35° TO +85° C
- * COIL TERMINALS #6 BINDING HEAD SCREWS
TORQUE TO 7 IN-LB
- * SINGLE POLE / SINGLE THROW
- * MAGNETICALLY ACTIVATED
- * MERCURY TO MERCURY CONTACTOR

