



MERCURY DISPLACEMENT INDUSTRIES, INC.

Post Office Box 710 - U.S. 12 East - Edwardsburg, Michigan 49112-0710

Phone (269) 663-8574 - Fax (269) 663-2924

(800) 634-4077


DRO-120AP-4

NORMALLY OPEN TIME DELAY RELAY


ACCEPTS 6 TO 14 AWG

 939S
LISTED
INDUSTRIAL CONTROL
EQUIPMENT

 LR 41198
CERTIFIED

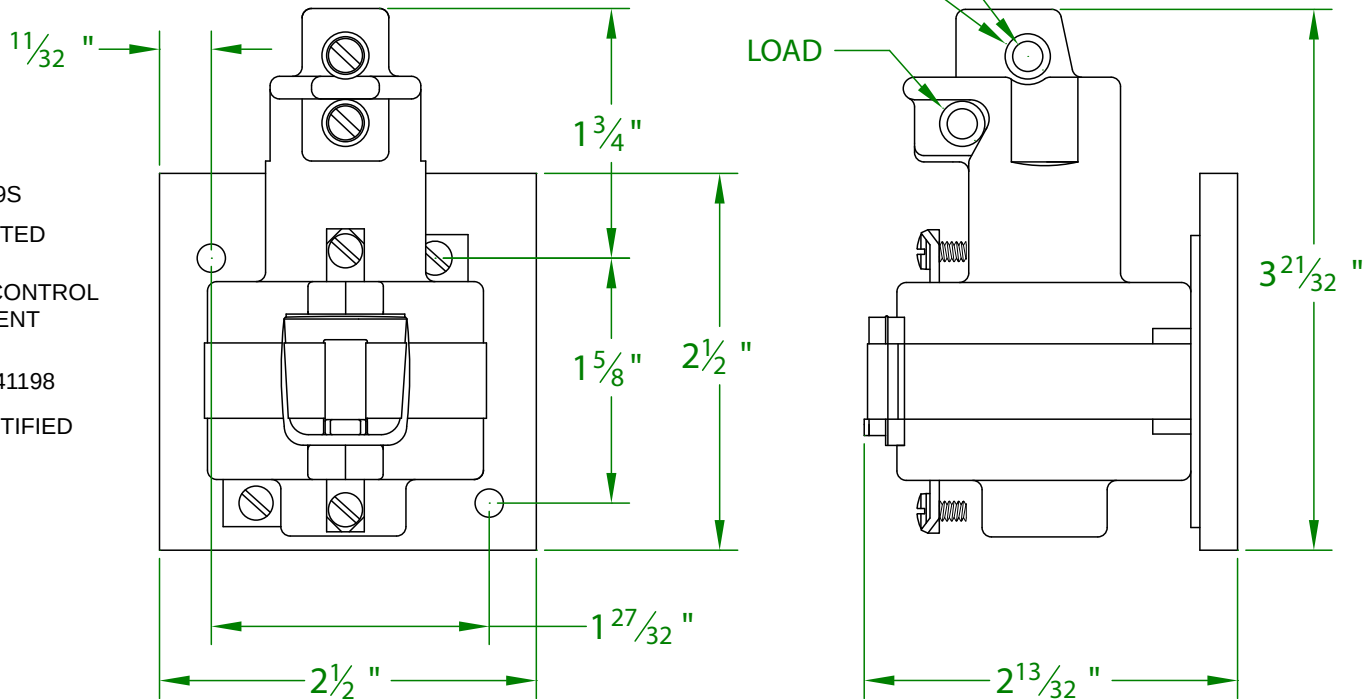

- * DIELECTRIC WITHSTAND 2,500 VAC RMS
- * RELEASE TIME 4 SECONDS
- * RATINGS:
 - CONTACTS: 10 AMPS @ 120 VAC
 - PILOT DUTY RATING 720 VA
 - COIL: 120V 50/60 Hz
- * TEMPERATURE RANGE -35° TO +85° C
- * COIL TERMINALS #6 BINDING HEAD SCREWS
TORQUE TO 7 IN-LB
- * SINGLE POLE / SINGLE THROW
- * MAGNETICALLY ACTIVATED
- * MERCURY TO MERCURY CONTACTOR

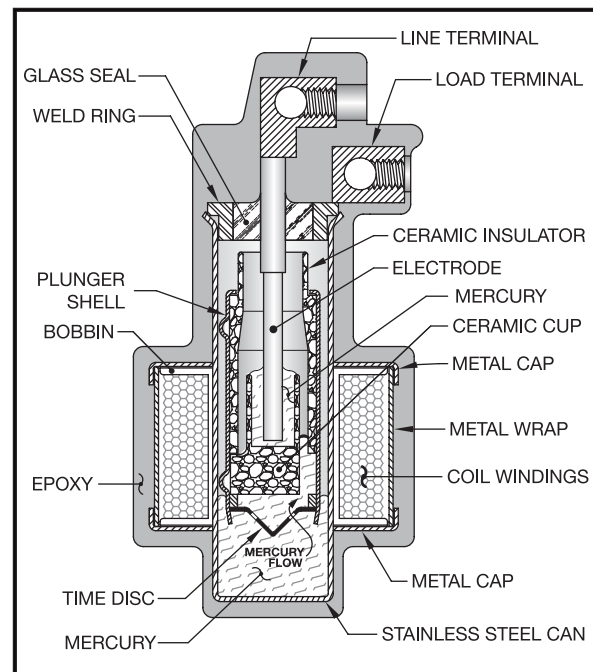

Contactors - Relays - Switches

J.J.S. 02-13-2012