



MERCURY DISPLACEMENT INDUSTRIES, INC.

Post Office Box 710 - U.S. 12 East - Edwardsburg, Michigan 49112-0710

Phone (269) 663-8574 - Fax (269) 663-2924


(800) 634-4077

PANEL#: 50A704-C6

CONNECTION DIAGRAM

REQUIRED TORQUE FOR TERMINAL BLOCK SCREWS IS 16 in-lbs.

PUMP, FLOAT & POWER CONNECTIONS

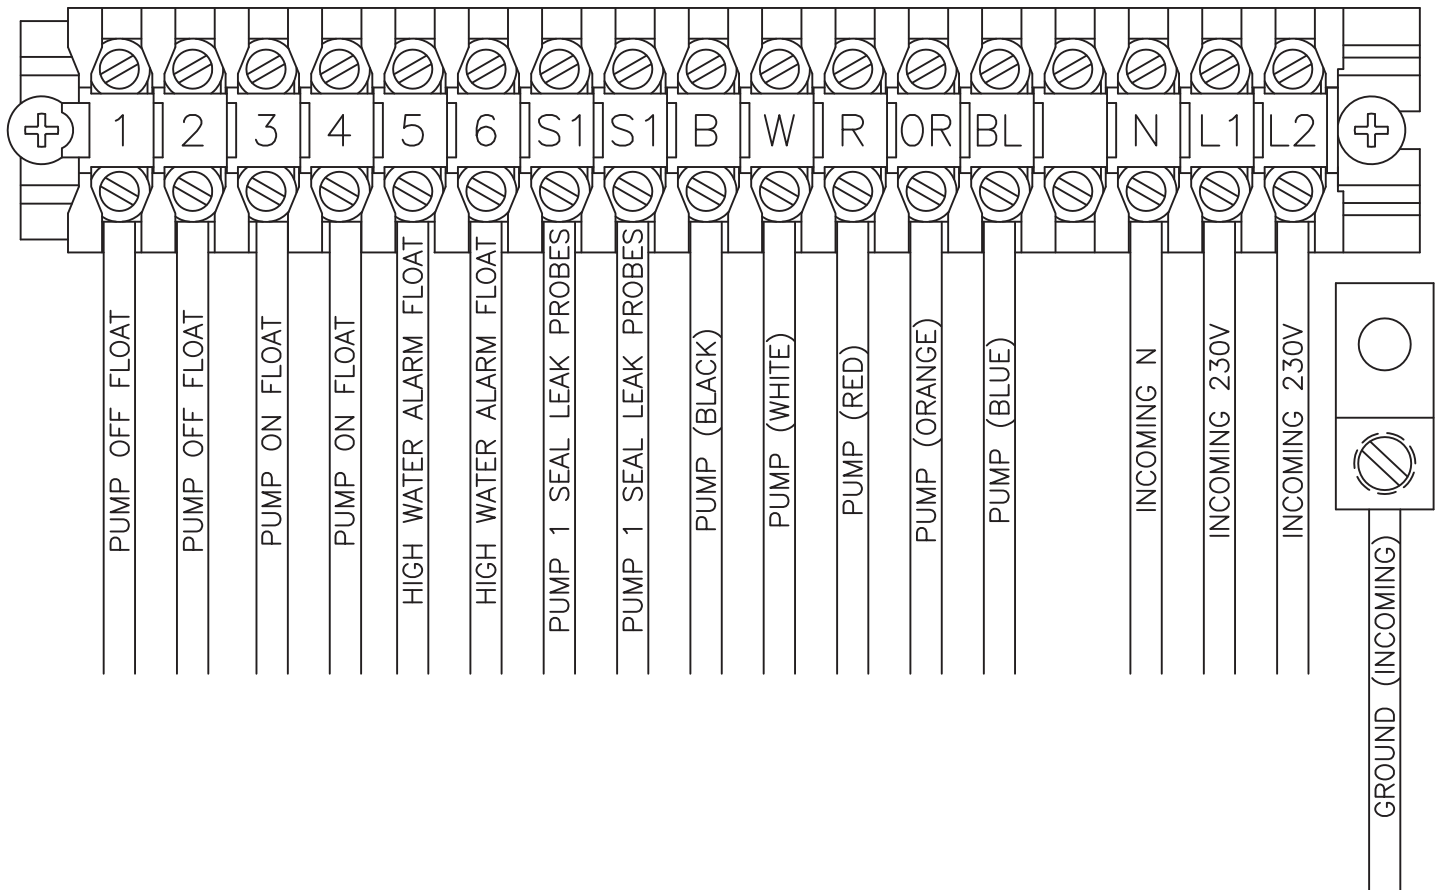


Contactors - Relays - Switches

<http://www.mdious.com>

POWER CIRCUIT
230V - 1PH

PUMP MOTOR MUST HAVE INTERNAL OVERLOAD PROTECTION.

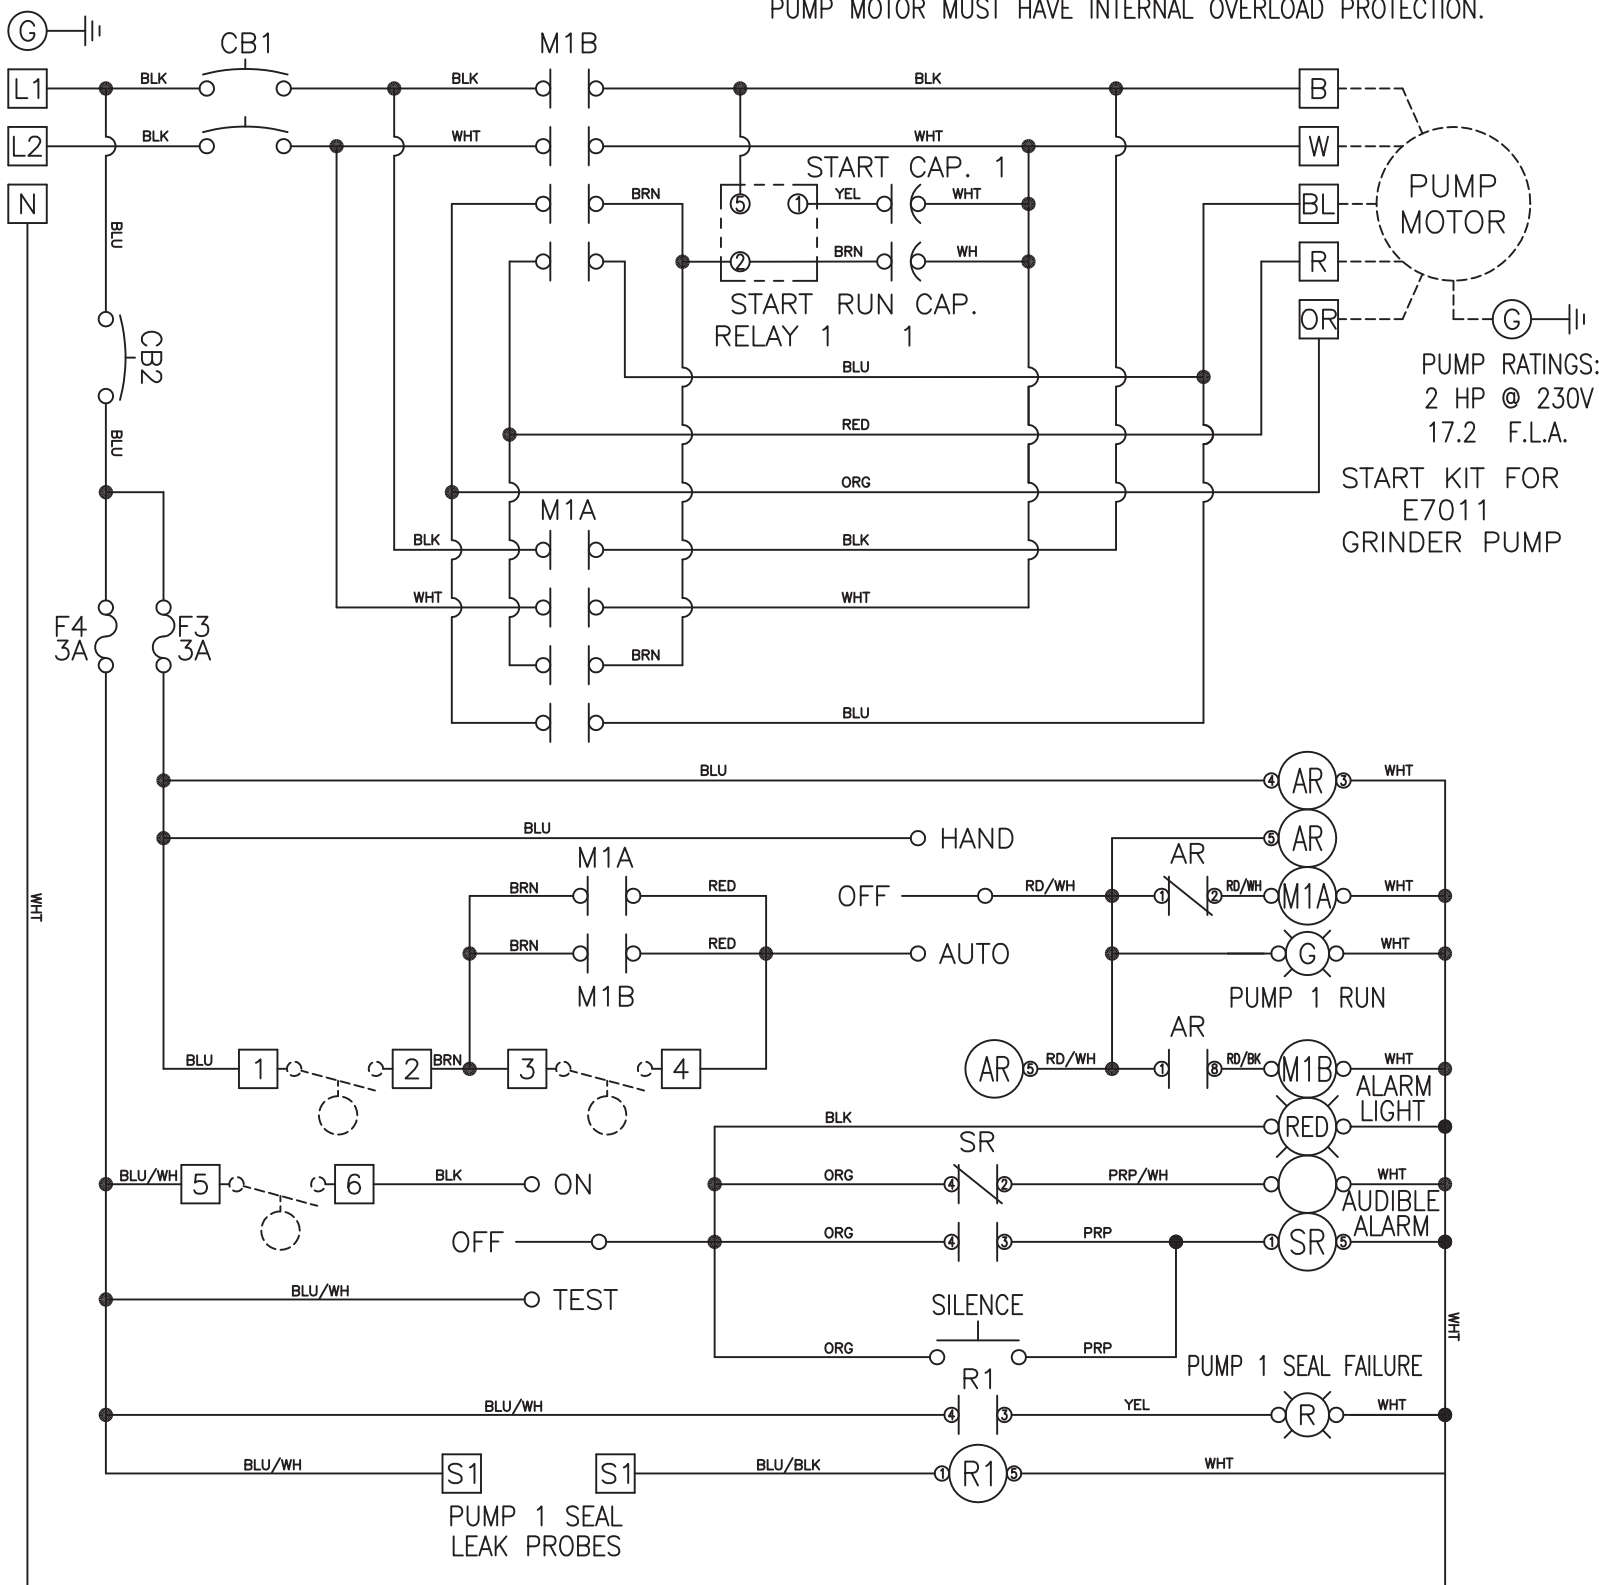

- NOTES: FLOAT SWITCH TO BE RATED 2 AMPS @ 120V MINIMUM.
 MAIN PANEL DISCONNECT MUST BE PROVIDED BY INSTALLER.
 DASHED LINES INDICATE ITEM NOT CONTAINED IN THE PANEL.
 FIELD WIRING MUST BE A MINIMUM OF 60° COPPER WIRE.